

Sound reduction index in accordance with PN - EN ISO 10140-2:2021-10E

Laboratory measurements of airborne sound insulation of building elements

Client: **NorDan AS**

Measurement date: **29.08.2024**

Address: **Stasjonsveien 46, N-4460 Moi, Norway**

Test specimen: **ND NTech Villa double balcony door – wooden door, 2l system
Inward-opening**

One active and one passive leaf, door leaf with movable post.

The same glazing in both door leaves. Glazing:

6,38 / 16 Ar / 6 (GLASSOLUTIONS)

Size of door: **1588 x 2088 x 80 mm** (wide x height x door leaf frame thickness)


Test specimen mounted by: **Gryfitlab Sp. z o.o.**

Mass per unit area: **kg/m²**

The surface area of test specimen: **3,43 m²**

Parameter	Receiving room	Source room
Air temp. [°C]	22,7	22,6
Humidity [%]	61	60
Pressure [hPa]	1016	1016
Volume [m ³]	324	372

Frequency [Hz]	Test results with uncertainty	
	R [dB]	U _{CR} [dB]
50	17,6	3,4
63	21,3	3,4
80	19,5	3,5
100	24,6	2,0
125	23,7	2,1
160	15,3	2,1
200	22,9	1,8
250	30,3	1,2
315	34,0	1,2
400	31,4	1,3
500	38,9	1,2
630	38,4	1,2
800	37,6	1,1
1000	34,7	1,1
1250	34,1	1,1
1600	34,5	1,0
2000	33,8	1,0
2500	34,7	1,0
3150	36,7	1,0
4000	39,7	0,9
5000	44,3	1,2

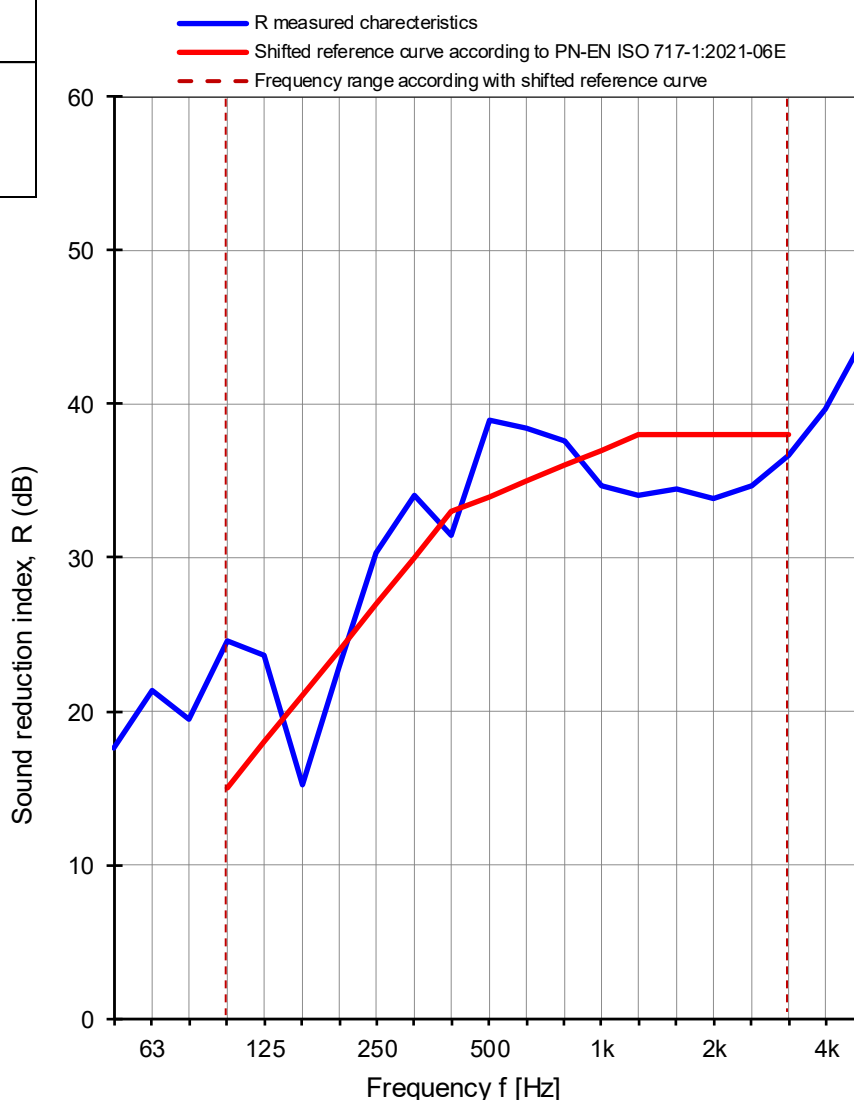

Measurement uncertainty of sound reduction U_{CR}

Confidence level 95% at coverage factor, k=2

Weighted sound reduction index in accordance with PN-EN ISO 717-1:2021-06E

R_w (C; C_{tr}) = 34 (-1; -4) dB

C₅₀₋₃₁₅₀ = -1 dB

C₅₀₋₅₀₀₀ = 0 dB

C₁₀₀₋₅₀₀₀ = 0 dB

C_{tr, 50-3150} = -5 dB

C_{tr, 50-5000} = -5 dB

C_{tr, 100-5000} = -4 dB

GRYFITLAB Sp. z o.o. Laboratory of Acoustics

No. of test specimen: **GLA-1676.14 / 24**

Date of analysis: 29.08.2024

Signature: Robert Dybicz